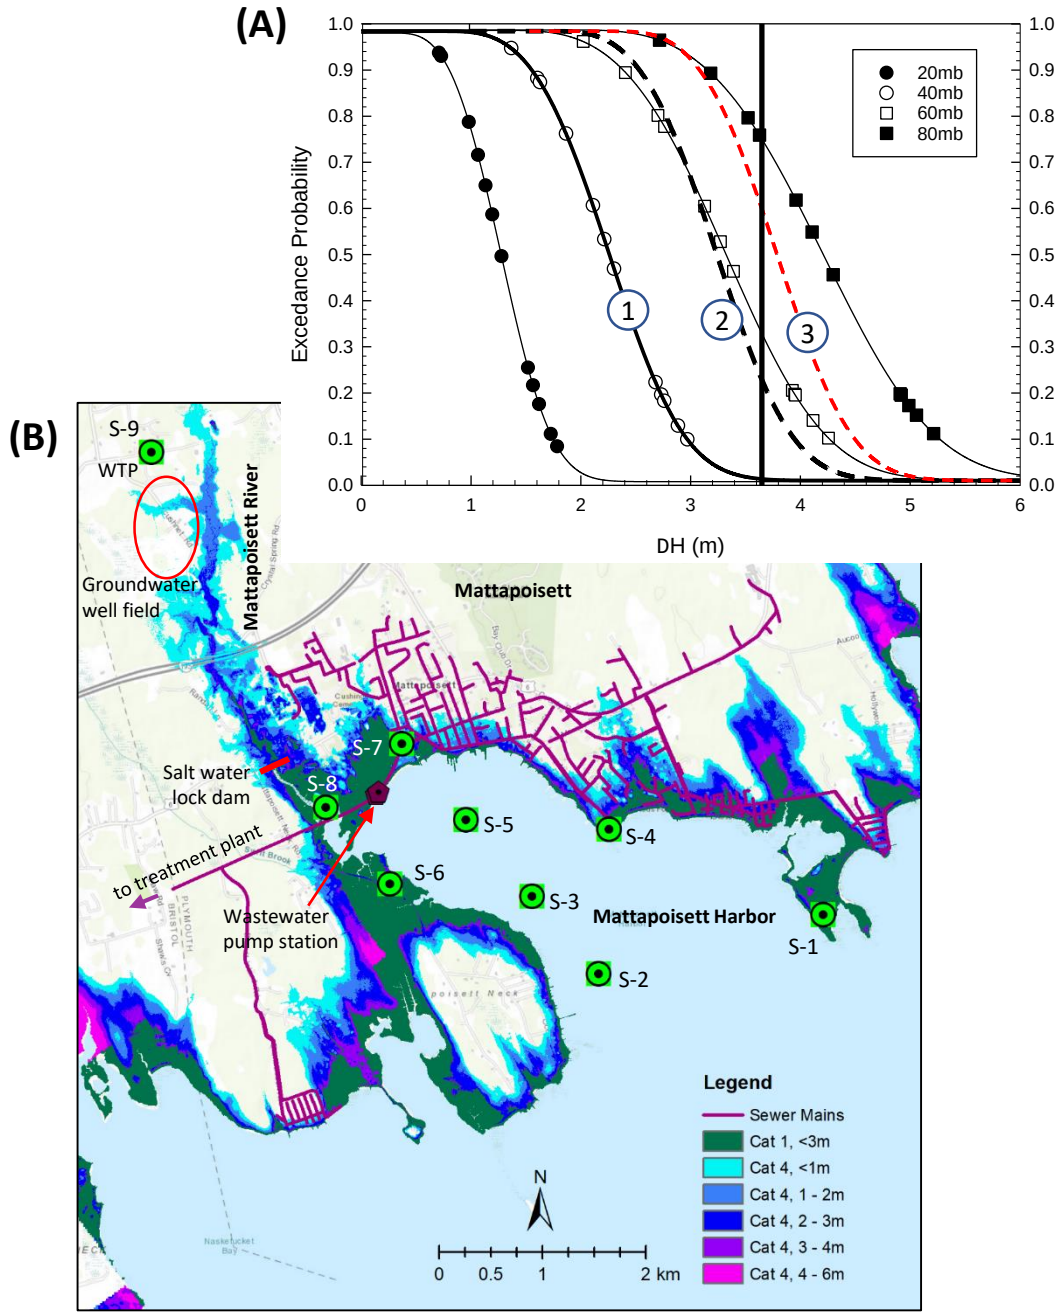
(A)
Excedance Probability
DH (m)
20mb
40mb
60mb
80mb
1
2
3
(B)
S-9
WTP
Groundwater
well field
Mattapoisett River
Mattapoisett
S-7
Salt water
lock dam
S-8
S-5
S-4
to treatment plant
S-6
S-3
Wastewater
pump station
Mattapoisett Harbor
S-1
S-2
Legend
Sewer Mains
Cat 1, <3m
Cat 4, <1m
Cat 4, 1 - 2m
Cat 4, 2 - 3m
Cat 4, 3 - 4m
Cat 4, 4 - 6m
N
0 0.5 1 2 km